

DOE/MC/31393-96/C0546

Development of Advanced Hot-Gas Desulfurization Sorbents

Authors:

K. Jothimurugesan
Adeyinka A. Adeyiga
Santosh K. Gangwal

RECEIVED

NOV - 3 1995

OSTI

Contractor:

Hampton University
Department of Engineering
Hampton, VA 23668

Contract Number:

DE-FG21-94MC31393

Conference Title:

Advanced Coal-Fired Power Systems '95 Review Meeting

Conference Location:

Morgantown, West Virginia

Conference Dates:

June 27-29, 1995

Conference Sponsor:

U.S. Department of Energy, Morgantown Energy Technology Center
(METC)

MASTER

JA

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

This report has been reproduced directly from the best available copy.

Available to DOE and DOE contractors from the Office of Scientific and Technical Information, 175 Oak Ridge Turnpike, Oak Ridge, TN 37831; prices available at (615) 576-8401.

Available to the public from the National Technical Information Service, U.S. Department of Commerce, 5285 Port Royal Road, Springfield, VA 22161; phone orders accepted at (703) 487-4650.

PB.15 Development of Advanced Hot-Gas Desulfurization Sorbents

CONTRACT INFORMATION

Contact Number DE-FG21-94MC31393

Contractor Hampton University
 Department of engineering
 Hampton, VA 23668
 (804) 727-5288

Contractor Project Manager K. Jothimurugesan

Principal Investigators K. Jothimurugesan
 Adeyinka A. Adeyiga
 Santosh K. Gangwal (RTI)

DOE Project Officer Kamalendu Das

Period of Performance October 1, 1994 to September 30, 1995

Schedule and Milestones

FY 1994 Program Schedule

	O	N	D	J	F	M	A	M	J	J	A	S
Test Plan	_____											
Sorbent Preparation	_____											
Sorbent Screening	_____											

OBJECTIVES

The objective of this study is to develop hot-gas cleanup sorbents for relatively lower temperature application, with emphasis on the temperature range from 343-538°C (650-1000°F). A number of formulations will be prepared and screened for testing in a 1/2-inch fixed bed reactor at high pressure (1 to 20 atm) and high temperatures using simulated coal-derived fuel-gases. Screening criteria will include, chemical reactivity, stability, and

regenerability over the temperature range of 343°C (650°F) to 538°C (1000°F). Each formulation will be tested for up to 5 cycles of absorption and regeneration. To prevent sulfation, catalyst additives will be investigated, which would promote a lower ignition of the regeneration. Selected superior formulation will be tested for long term (up to least 30 cycles) durability and chemical reactivity in the reactor.

BACKGROUND INFORMATION

Advanced high-efficiency integrated gasification combined cycle (IGCC) power systems are being developed to produce power from coal under the U.S. Department of Energy's (DOE's) multibillion dollar Clean Coal Technology (CCT) Program (Gangwal et al., 1993). In these advanced systems, coal is gasified to produce a gas at high temperature and high pressure (HTHP) conditions. The hot gas is cleaned of contaminants, primarily particulates and sulfur gases such as hydrogen sulfide (H_2S) and burned in a combustion turbine. IGCC systems are capable of higher thermal efficiency and lower gaseous, liquid, and solid discharges than conventional pulverized-coal-fired power plants. Hot gas cleanup offers the potentially key advantages of higher plant thermal efficiencies and lower costs due to the elimination of fuel gas cooling and associated heat exchangers.

Sorbents based on zinc oxide are currently the leading candidates and are being developed for moving-, and fluidized-bed reactor applications. Zinc oxide based sorbents can effectively reduce the H_2S in coal gas to 10 ppm levels. Most of the hot-gas desulfurization research has focused on the development of mixed-metal oxide sorbents for application at 538°C (1000°F) to 760 °C (1400°F).

This project aims to develop hot-gas cleanup sorbents for relatively lower temperature applications, 343°C (650°F) to 538°C (1000°F) with emphasis on the temperature range from 400 to 500°C. There are a number of reasons for development of sorbents suitable for this temperature range. Recent economic evaluations (Novem, 1991; Leininger et al., 1992; Rutkowski et al., 1993) have indicated that the thermal efficiency of IGCC systems increases rapidly with the temperature of hot-gas cleanup up to 350°C and then very slowly as the temperature is increased further. This suggests that the

temperature severity of the hot-gas cleanup devices can be reduced without significant loss of thermal efficiency. Another important reason to reduce hot-gas cleanup severity is to reduce the operating temperatures and temperature swings of on-off valves and vessels for cyclic fixed-bed desulfurization/regeneration systems, lock-hopper valves for moving-bed applications, and the turbine load control valves. Finally, the current plans in Europe call for hot-gas desulfurization system operation at 350-600 °C. Also iron-oxide process development studies in Japan have concentrated on a temperature range of 400-600 °C. Thus development of suitable advanced sorbents in this temperature range is necessary to remain in the forefront in hot-gas cleanup technology.

PROJECT DESCRIPTION

Sorbent Preparation and Characterization

A highly promising method was recently developed under this contract to prepare suitable sorbents. Zinc oxide based sorbents was prepared using this proprietary technique. The following analytical techniques was used to characterize the fresh, sulfided and regenerated sorbents

1. X-ray Diffraction (XRD) for crystalline phase.
2. Surface area measurement will be based on the standard BET method.
3. Hg-porosimetry for pore volume, bulk density, average pore diameter and pore size distribution determination.
4. Atomic Absorption (AA) Spectrometry for elemental composition analysis.

Experimental Setup

The sorbents were evaluated with respect to their sulfidation-regeneration performance, in a packed-bed microreactor. The set-up is shown schematically in Figure 1.

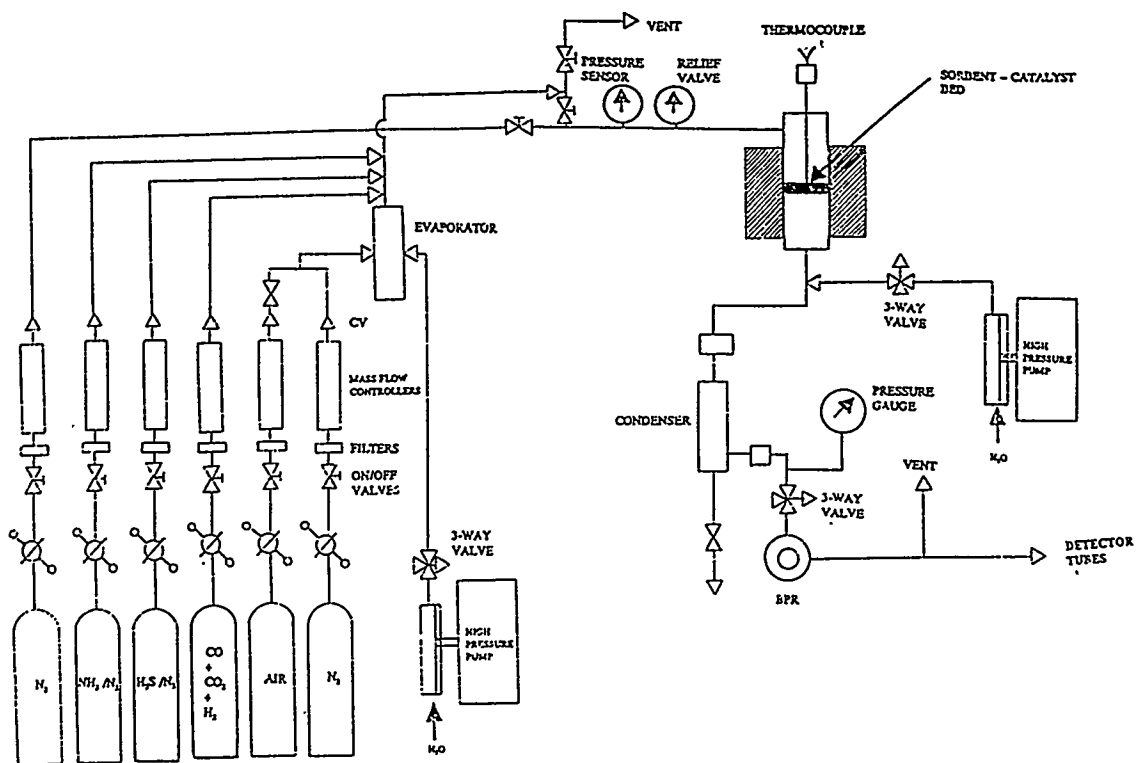


Figure 1. Schematic of the Reactor System for Sulfidation and Regeneration Studies

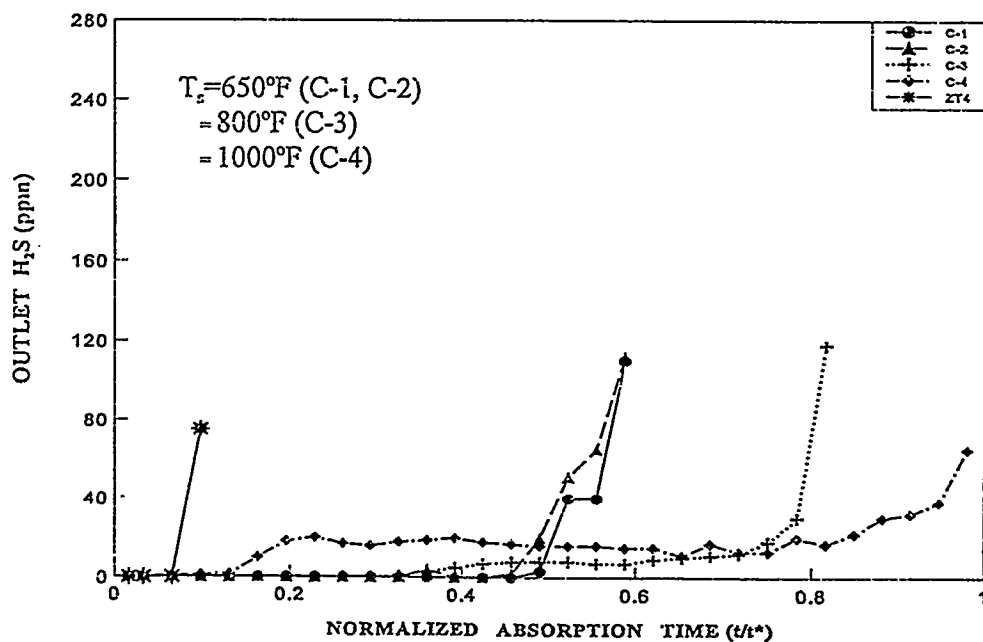


Figure 2. H_2S Breakthrough Curves in Successive Sulfidation Cycles of Sorbent MCRH-1

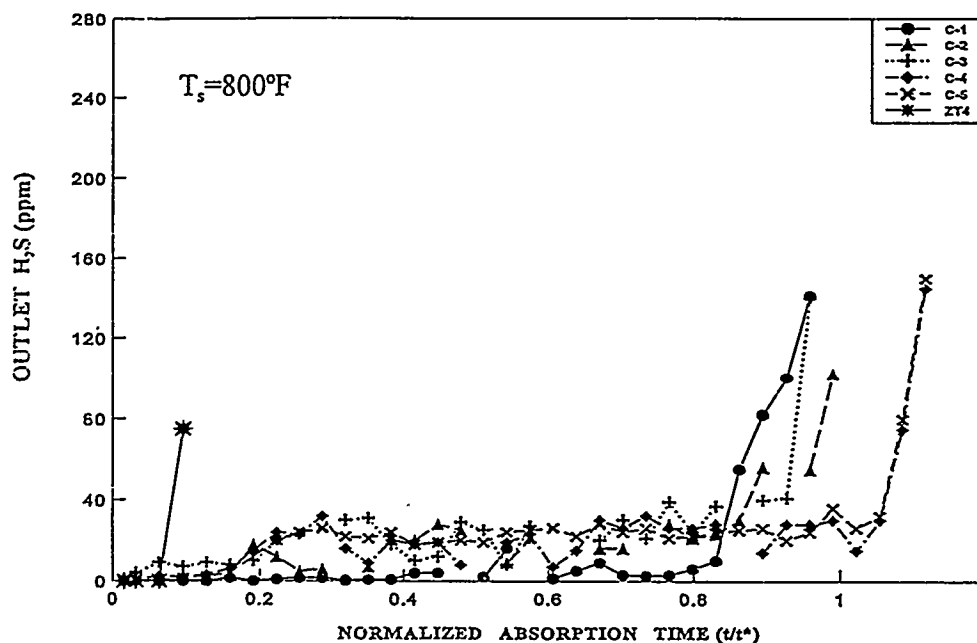


Figure 3. H₂S Breakthrough Curves in Successive Sulfidation Cycles of Sorbent MCRH-10

This system includes a feed gas supply section in which the simulated coal gas components, supplied from standard high-pressure cylinders equipped with pressure regulators, are mixed and metered by a battery of electronic mass flow controllers. Steam is added to the mixed dry gas by vaporizing liquid water injected into the gas stream at a controlled rate by a high pressure metering pump. The pressure inside the reactor is controlled by a back pressure regulator and measured by an electronic pressure sensor. The bed temperature is measured by a chromel-alumel thermocouple. The product gas is passed through ice traps to condense water, and then analyzed for H₂S, and SO₂ by Matheson gas detector tubes.

TEST RESULTS

The ZnO-based sorbent (MCRH-1) was evaluated in a sulfidation gas mixture containing (in mole%): H₂=10%, CO=15%, CO₂=5%, H₂S=1%, H₂O=15% and bal N₂. Figure 2 show the H₂S breakthrough profiles

as a function of normalized time. In tests with the MCRH-1 sorbent conducted at 800°F, the sorbent conversion at breakthrough was 80 percent. In fact, the H₂S level remained at 0 ppm until 17 percent sorbent conversion and then gradually increased to ~5 ppm when conversion reached 80 percent. The sorbent conversion at 650 and 1000°F was 60 and 100 percent respectively. Under the same conditions, at 800°F ZT-4 (currently the leading sorbent) conversion was less than 10%.

Figure 3 show the H₂S breakthrough profiles for a another ZnO-based sorbent(MCRH-10) as a function of normalized time. Complete (100%) sorbent conversion was observed at breakthrough at 800°F and the pre-breakthrough H₂S level was below 35 ppm.

FUTURE WORK

Various formulations of sorbents with

catalyst additives will be prepared and investigated for their ability to be regenerated at lower temperature.

PUBLICATION/PRESENTATION

K. Jothimurugesan, A.A. Adeyiga and S.K. Gangwal "Development of Advanced Hot-Gas Desulfurization Sorbents" Project Review Meeting, DOE/METC, February 24, 1994

K. Jothimurugesan, A.A. Adeyiga and S.K. Gangwal "Development of Advanced Hot-Gas Desulfurization Sorbents" 1995 Annual AIChE Meeting, November-17, Miami Beach, FL. Abstract submitted

REFERENCES

Gangwal, S.K., Gupta, R., and McMichael, W.J. "Sulfur Control Options For igcc Systems", Proceedings of UNDEERC Low-Rank Fuels Symposium, St. Louis, MO, 1993.

Leininger, T., et al., "Integration and Testing of Hot Desulfurization and Entrained Flow Gasification for Power Generation Systems," Proceedings of the 12th Annual Gasification and Gas Stream Cleanup Contractor's Review Meeting, Vol. 1, DE93000228, p.95, 1992.

NOVEM. System Study high temperature gas cleaning at IGCC systems. Netherlands Agency for Energy and the Environment, 1991.

Rutkowski, M., et al., "IGCC Database and Hot Gas Cleanup Systems Studies," Proceedings of the Coal-Fired Power Systems 93-Advances in IGCC and PFBC Review Meeting, DOE/METC-93/6131 (DE93000289), p.359, 1993.