



Eckardtmesser	
Nr.	Größe
E <sub>1</sub>	4
E <sub>2</sub>	1
E <sub>3</sub>	1
E <sub>4</sub>	2
E <sub>5</sub>	2
E <sub>6</sub>	4
E <sub>7</sub>	5
E <sub>8</sub>	4
E <sub>9</sub>	5
E <sub>10</sub>	5
E <sub>11</sub>	4
E <sub>12</sub>	4
E <sub>13</sub>	3
E <sub>14</sub>	5

Duplex-Kolbenpumpen		
D.P. Nr.	Antrieb	m <sup>3</sup> /h
1D	elektr.	50
2D	'	50
3D	'	5
4D	Dampf	7,5
5D	elektr.	5
6D	'	15
7D	Dampf	7,5
8D	elektr.	15
9D		
10D		
11D		
12D		

Zentrifugalpumpen	
ZP. Nr.	m <sup>3</sup> /h
1Z	35
2Z	'
3Z	'
4Z	'

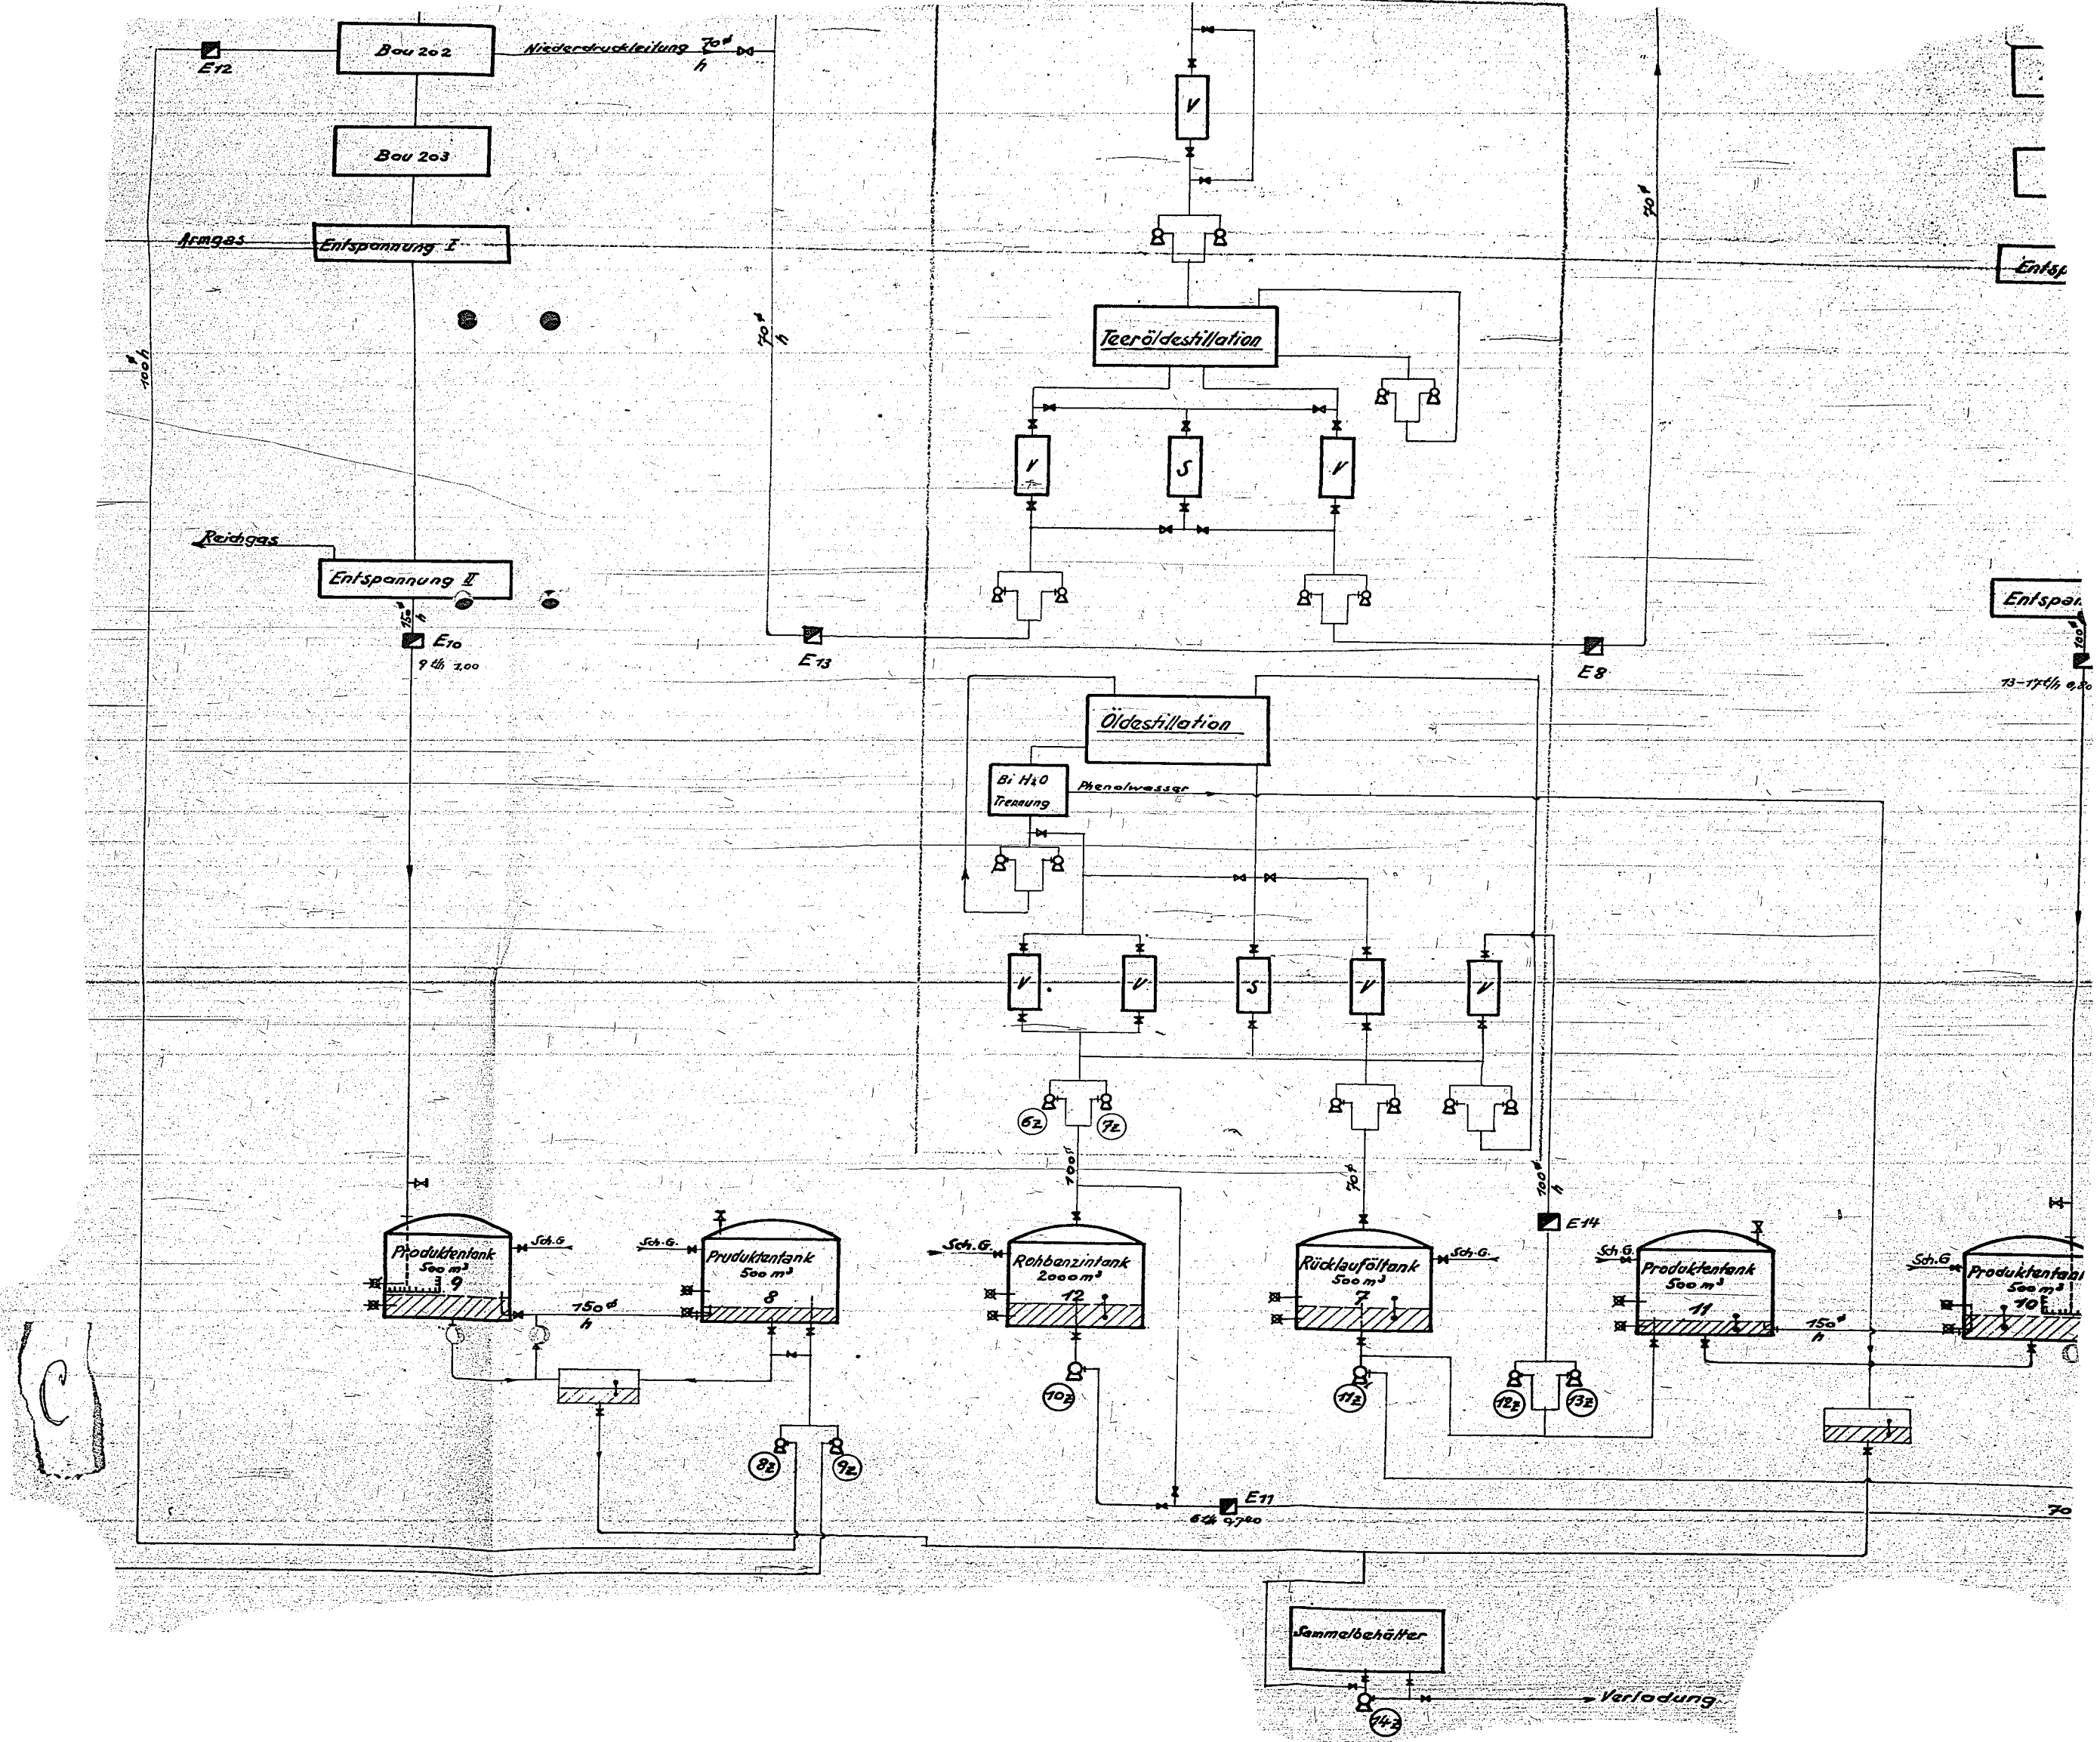

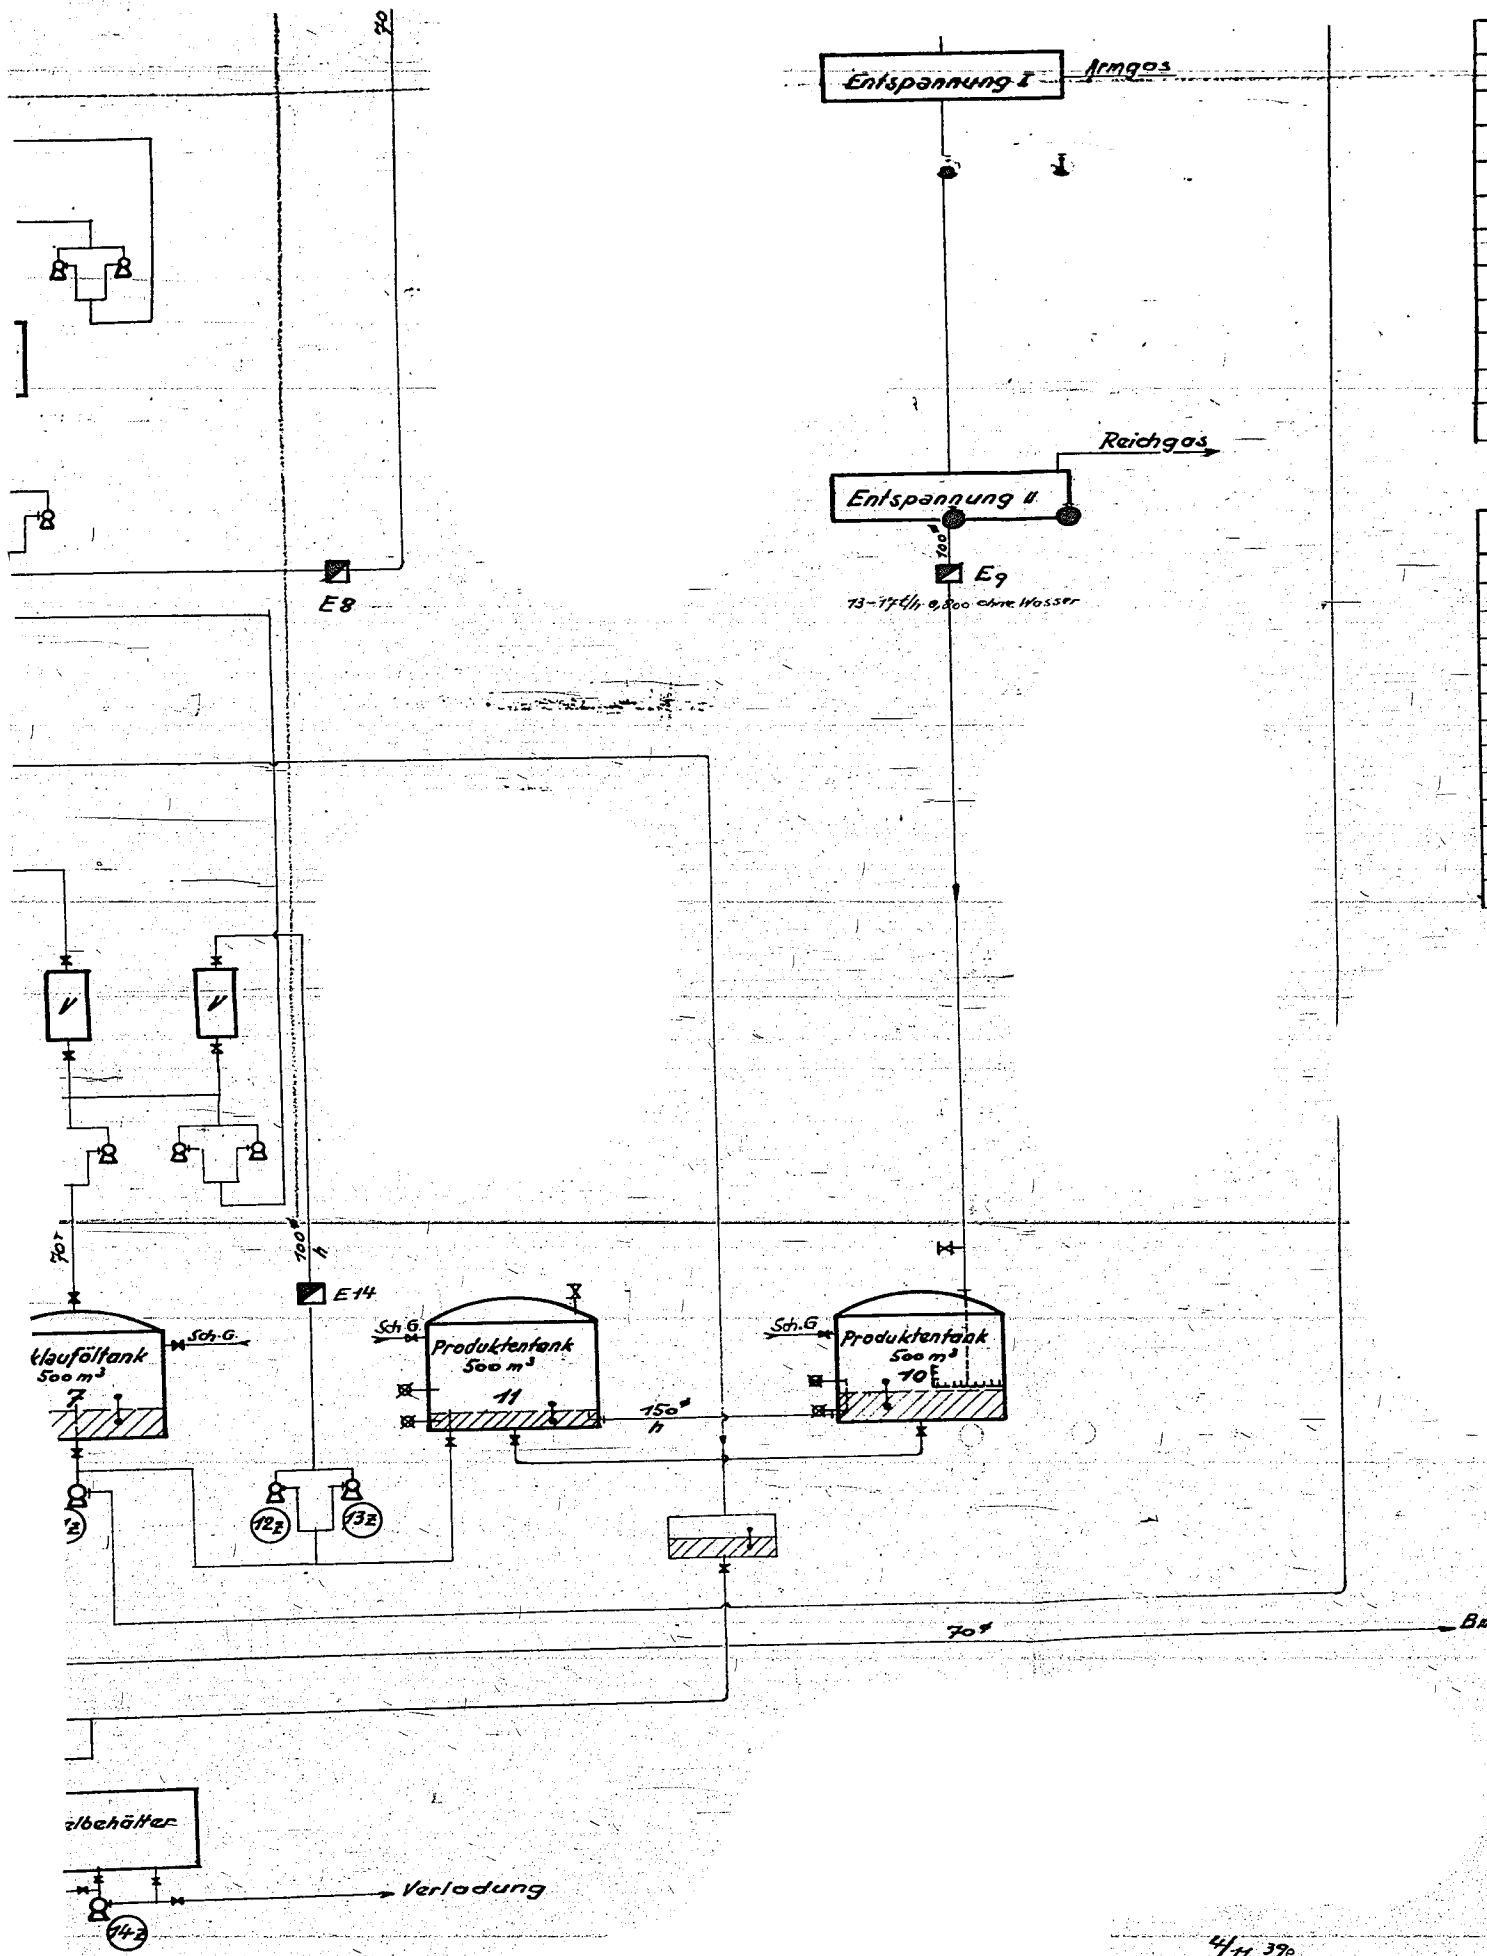

5z	1
6z	1
7z	1
8z	1
9z	1
10z	1
11z	1
12z	1
13z	1
14z	1
15z	150
16z	35

Tanks		Vorlagen	
mit Heizung	ohne Heizung	mit Heizung	ohne Heizung
1		a	
2		b	
3		c	
4		d	
5		e	
6		f	
	7		
8			
9			
	10		
	11		
	12		
207			

Zeichenerklärung	
ZP	Zentrifugalpumpen
DP	Duplexpumpe
V	Vorlage
S	Sieptank
h	beheizte Leitungen
Sch.G	Schutzgasnetz
⊗	Probierrahn
⊥	Schauglas
⊥	Prallfische
E	Edardtmesser
⊥	Lieferung Still

4/11 39e

Entwurf	Plan	Revis	Winterhall A. G. Kassel Werk Lützkendorf
Gepr.			
Maßstab	Schema zum Tanklager, H		180244e
			Erstellt für
			Erstellt durch